
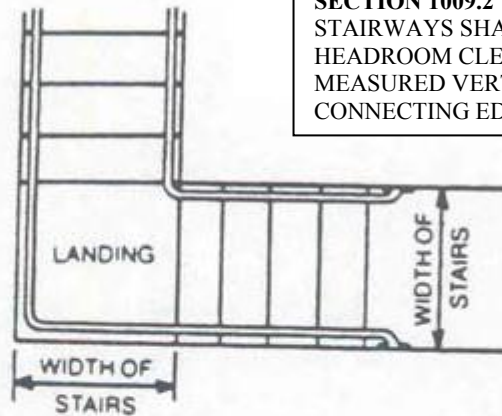


STAIRWAYS

2010 CALIFORNIA BUILDING CODE SECTION 1009

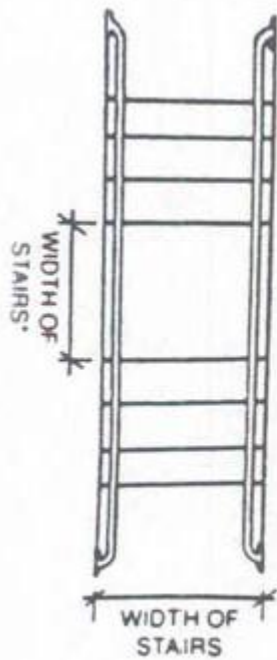


SECTION 1009.2

STAIRWAYS SHALL HAVE A MINIMUM HEADROOM CLEARANCE OF 80" MEASURED VERTICALLY FROM LINE CONNECTING EDGE OF THE NOSINGS.

SECTION 1009.1

MINIMUM STAIRWAY WIDTH: MINIMUM WIDTH SHALL NOT BE LESS THAN 44 IN.
EXCEPTION: 36 IN. FOR STAIRWAYS SERVING AN OCCUPANT LOAD OF LESS THAN 50.

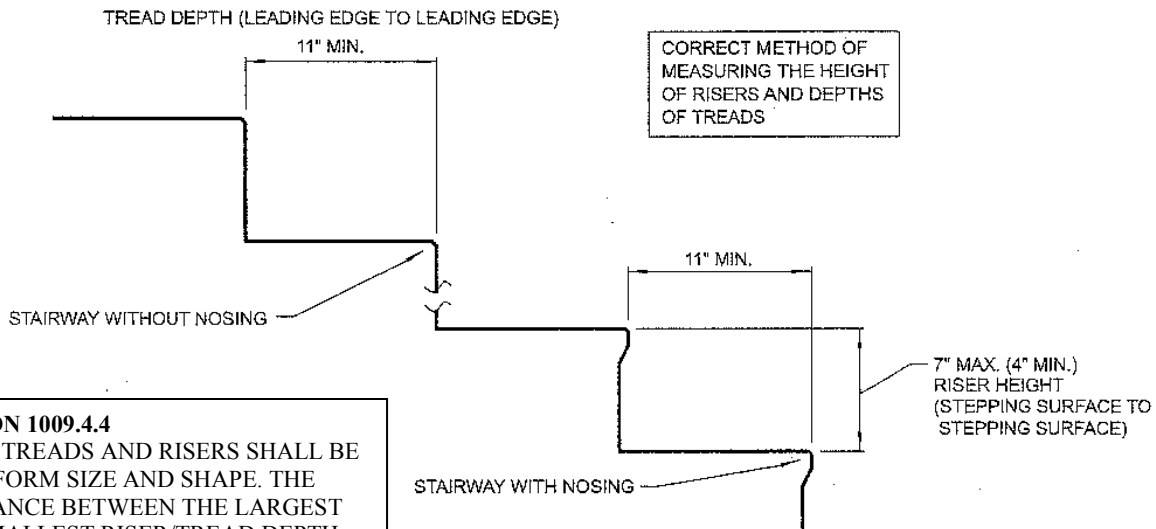

SECTION 1009.4.4

STAIRS TREADS AND RISERS SHALL BE OF UNIFORM SIZE AND SHAPE. THE TOLERANCE BETWEEN THE LARGEST AND SMALLEST RISER/TREAD DEPTH SHALL NOT EXCEED 3/8" IN ANY FLIGHT OF STAIRS.

SECTION 1009.4

MINIMUM RISER HEIGHT:
STAIR RISER HEIGHTS SHALL BE 7 IN. MAX, 4 IN. MIN.
MINIMUM TREAD DEPTHS:
TREAD DEPTHS SHALL BE 11 IN. MIN.
Exception: R3, DWELLING UNITS IN R2 AND U ACCESSORY TO R3 OCCUPANCY
RISER HEIGHT: 7 3/4" MAX; TREAD DEPTH: 10" MIN W/ 3/4" - 1 1/2" NOSING.